

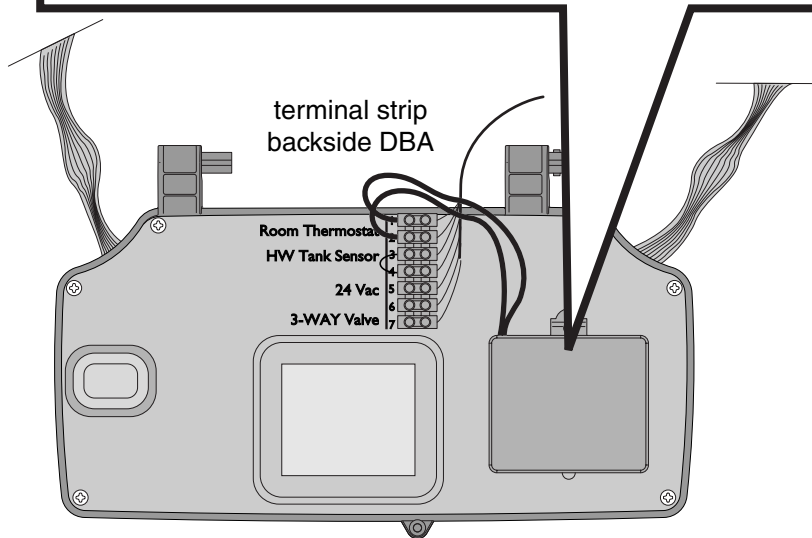


Installation in boilers with DBA

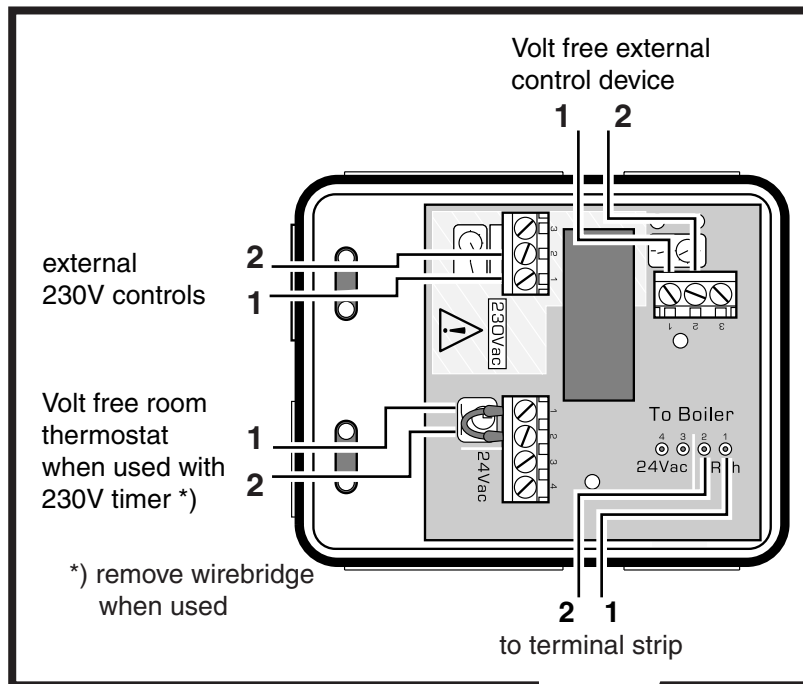

Installation in boilers with UBA 1.5

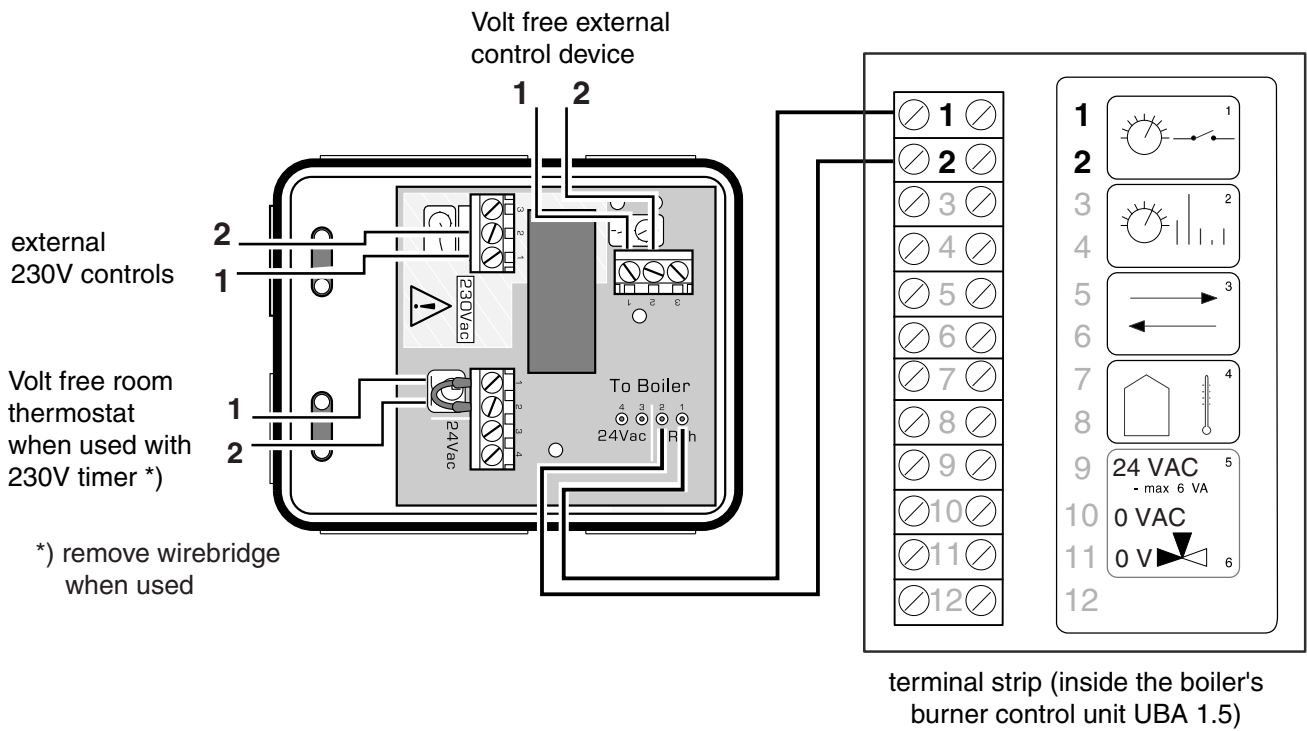

Installation in boilers with UBA 3

